


GENERAL NOTES:

- THIS DRAWING SHALL BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DRAWINGS & TECHNICAL SPECIFICATIONS.
- ALL INSTALLATIONS TO BE CARRIED OUT IN ACCORDANCE WITH CURRENT NSAI REGULATIONS AND GUIDELINES.
- TRENCH AND DUCT INSTALLATION IN RELATION TO THE EIRCOM SCOPE OF WORKS TO BE CARRIED OUT IN ACCORDANCE WITH EIRCOM WHITE GUIDANCE DOCUMENT CURRENT EDITION.
- PRIOR TO BACK FILLING AND MAKING GOOD EIRCOM TRENCH THE CONTRACTOR SHALL REQUEST EIRCOM ATTENDANCE TO SITE TO REVIEW AND APPROVE DUCTING PROVISION.

LEGEND


- JB4  EIRCOM ACCESS CHAMBER JB4 TYPE REFER TO EIRCOMS WHITE BOOK FOR ACCESS CHAMBER DETAILS
-  100mm Ø EIRCOM GREY WAVIN DUCT WITHIN DEEP SANDED TRENCH BY MAIN CONTRACTOR REFER TO DETAIL 'A'

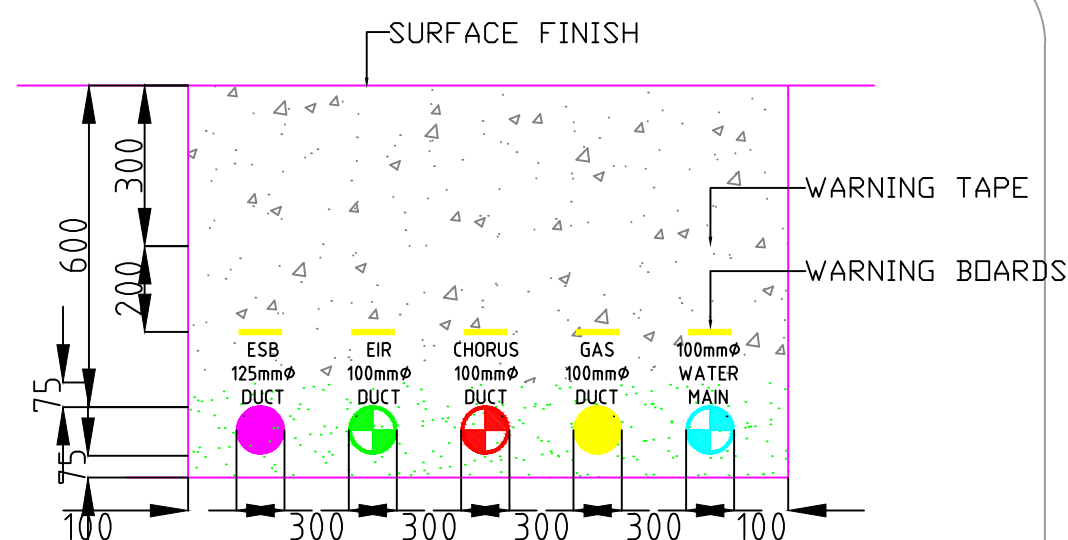

NOTES:

- FOR GAS SERVICES A MINIMUM COVER OF 375mm IS REQUIRED AT LOWEST POINT OF THE G.R.P. SLEEVE BEND. 550mm MINIMUM COVER IS REQUIRED OVER THE TAPPING TEE.
- FOR GAS SERVICES IN A CARRIAGEWAY OR ROAD A MINIMUM DEPTH OF COVER OF 750mm IS REQUIRED.
- WHERE IT IS NECESSARY TO CROSS OR RUN CLOSE TO ANY OTHER SERVICE, A MINIMUM CLEARANCE OF 250mm IS RECOMMENDED.
- ALL GAS MAIN TRENCHES ARE TO BE EXCAVATED TO THE WIDTH OF THE OUTSIDE DIAMETER OF THE GAS PIPE PLUS 300mm.
- MARKER TAPE SHOULD BE PLACED OVER ALL SERVICES.

DETAIL A: TYPICAL TRENCH DETAIL FOR MULTIPLE UTILITY

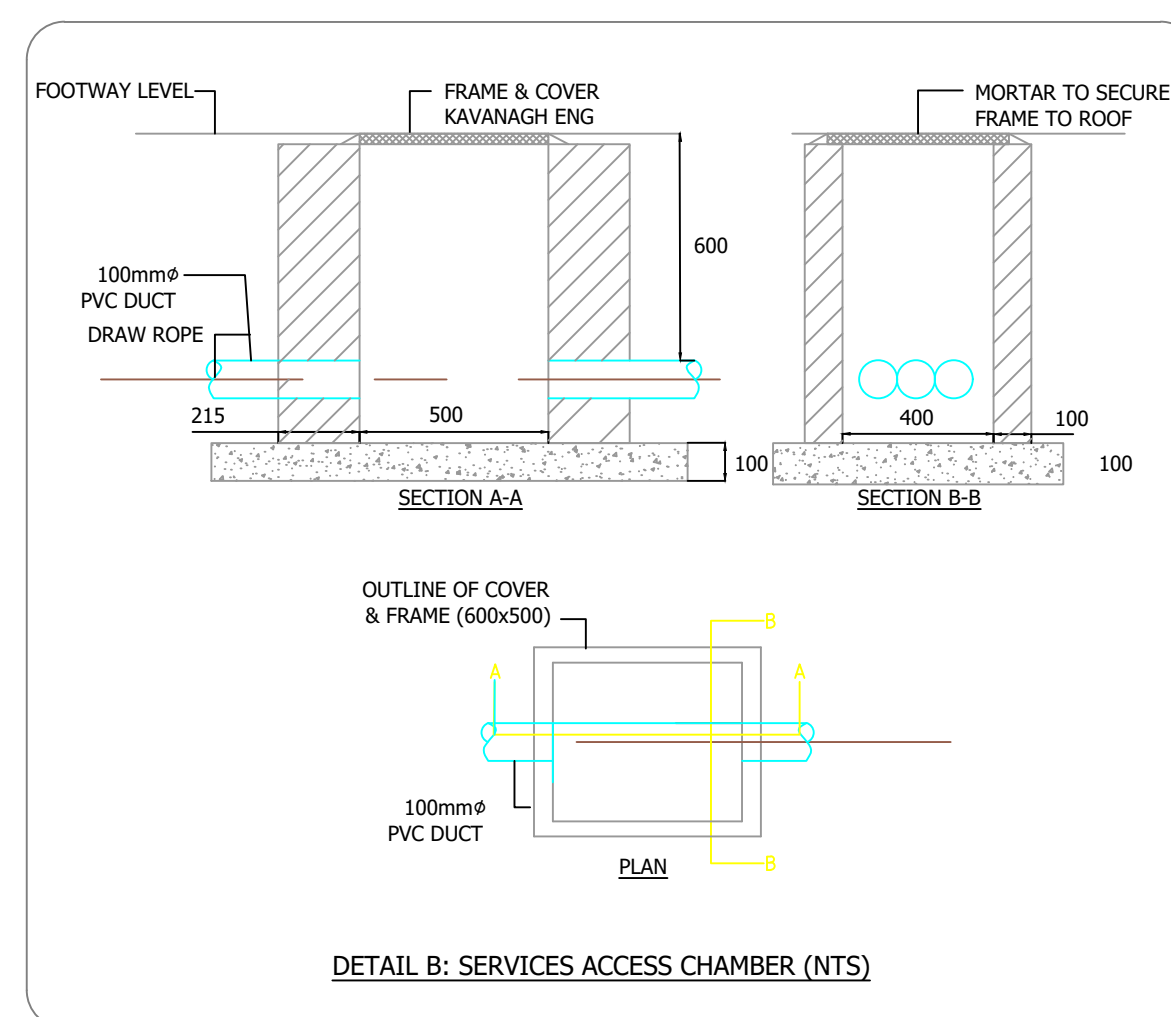

STAGE	INFORMATION 4
DATE	14/05/2024
SCALE(S)	1:500---A1
DRAWN	JM
CHECKED	JM

TITLE
Broadband Ducting Layout

MOLLOY CONSULTING ENGINEERS LTD.	
Cahercalla Road, Ennis, Co.Clare.	
Tel: 065-6891950. Mob: 086-3152764. Email: james@mollyconsulting.ie	
CLIENT Marshall Yards Development Company Ltd.	PROJECT Residential Development, Cartron, Oranmore, Co. Limerick.
DWG NO. PL2345-E-102-14	